Activity ID	Activity Name	Start	Finish	Actual Duration	Remaining Duration
Stickney Coordination Schedule		30-Mar-10 A	11-Jul-16	479	1161
Stickney Sludge Thickening Project		30-Mar-10 A	11-Jul-16	479	1161
S176	Contract Start	30-Mar-10 A		0	0
Concentration Tanks		01-Jun-10 A	08-Jan-15	434	769
CT27	Ozone Building	01-Jun-10 A	21-Jun-12	606	144
CT29	Effluent Water Pump Station	02-Jun-10 A	16-Aug-12	605	200
CT20	Roof Installations	14-Jun-10 A	02-Mar-11 A	259	0
CT26	Substation T7/T8	26-Aug-10 A	25-Apr-12	521	87
CT22	WAS Pump Station (Tanks 3 an 5)	07-Sep-10 A	19-Jul-12	509	172
CT24	Interim Pump Station (Tanks 1 and 2)	20-Jul-12	25-May-13	0	310
CT21	Sludge Control Building	19-Aug-12	03-Aug-13	0	350
CT21B	Bar Screens	26-May-13	17-Jun-13	0	23
CT23	Northside Pump Station (Tanks 4 and 6)	18-Jun-13	02-Jun-14	0	350
CT25	Gallery (Tanks 7 through 16)	18-Jun-13	08-Jan-15	0	570
Gravity Thickening Buildings		11-May-10 A	14-Jun-13	449	360
GTB30	Gravity Thickening Building	11-May-10 A	14-Jun-13	627	502
GTB31	Gravity Thickening Building - Support Building	11-May-10 A	30-May-13	627	487
GTB32	Bio-filters	13-May-10 A	21-Aug-12	625	205
GTB35	Gravity Thickening Flume	26-Apr-11 A	06-May-13	279	463
Digestion Buildings		08-Feb-11 A	11-Jul-16	254	1161
DB51A	Deliver Centrifuges to District to Replae Centrifuges 1, 2, 15,...	08-Feb-11 A	30-Jan-12	356	0
DB51	Pre-Digestion Bldg	30-Aug-11 A	15-Mar-15	153	1141
DB51B	Pumps Only	30-Aug-11 A	15-Oct-14	153	990
DB53	Post-Digestion	31-Oct-11 A	17-Jun-12	91	140
DB54	Service Tunnel	31-Oct-11 A	09-Apr-12	91	71
DB52	Pre-Digestion Bldg - North Addition	10-Mar-12	11-Nov-12	0	247
DB51C	Mixed Sludge Centrifuges 11, 12, 13, 14	16-Oct-14	16-Oct-14	0	0
DB51D	Was Centrifuges 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 15, 16	16-Oct-14	11-Jul-16	0	635
Sludge Blending Facility		26-Oct-10 A	23-Feb-13	329	280
SBF60	Sludge Blending Facility	26-Oct-10 A	23-Feb-13	460	391
SW Clarifier Substation		28-Feb-11 A	07-Aug-12	240	137
SWS70	SW Clarifier Substation	28-Feb-11 A	07-Aug-12	336	191
Laramie Gate House		28-Jun-10 A	01-May-12	415	67
GH80	Laramie Gate House	28-Jun-10 A	01-May-12	579	93
Site Work		06-Aug-10 A	16-Jun-14	386	621
SW010	City Water Line 7	06-Aug-10 A	13-May-11 A	279	0
SW030	Effluent Water Line 1 - Tunnel (Temp)	19-Aug-10 A	05-Dec-11 A	472	0
SW020	Effluent Water Line 7	03-Sep-10 A	13-May-11 A	251	0
SW070	Effluent Water Line 11	13-Sep-10 A	22-Jun-11 A	281	0
SW050	Recycle Line from Post-Digestion Bldg to South	14-Sep-10 A	30-Jan-12	502	0
SW040	Underground Electric from Central Boiler to Area 31	11-Oct-10 A	29-Feb-12	475	31
SW130	NS Sludge Emergency Bypass Connection	15-Aug-11 A	27-Apr-12	168	89
SW120	Thickened PREL from Gravity to Blend Facility	03-Oct-11 A	16-Apr-12	119	24
SW080	Effluent Water Line 10	05-Jan-12 A	25-Jan-12 A	20	0
SW110	Effluent Water Line 9	26-Jan-12 A	24-Mar-12	4	0
SW060	Relocate Area 52 Manhole	30-Jan-12	09-Mar-12	0	40
SW090	WAS Force Main from Thickening 24 to 51	30-Jan-12	09-Mar-12	0	40
SW100	NS Sludge Line from Thickening Centrifuges 29 to 52	10-Mar-12	23-Mar-12	0	14
SW140	Effluent Water Line 1 - Tunnel (Permanent)	18-Jun-13	16-Jun-14	0	364
Westside Imhoff Battery A and Skimming Tank Demol...		01-Sep-10 A	15-Mar-13	368	295
A1080	Contract Start Date	01-Sep-10 A		0	0
A1030	Exterior Work	01-Dec-10 A	13-Mar-13	424	409
A1010	Battery B	14-Dec-10 A	02-Jan-13	411	339
A1020	Battery C	04-Jan-11 A	14-Dec-12	391	320
A1060	Sludge Screen Building	08-Feb-11 A	24-Feb-12	356	26
A1070	West Side Pump Station	01-Apr-11 A	06-Jan-12 A	280	0
A1050	Skimming Tanks	26-Apr-11 A	15-Mar-13	279	411
A1000	Battery A	01-Oct-11 A	27-Feb-13	121	395
A1040	Grit Building	30-Jan-12	03-Feb-12	0	5

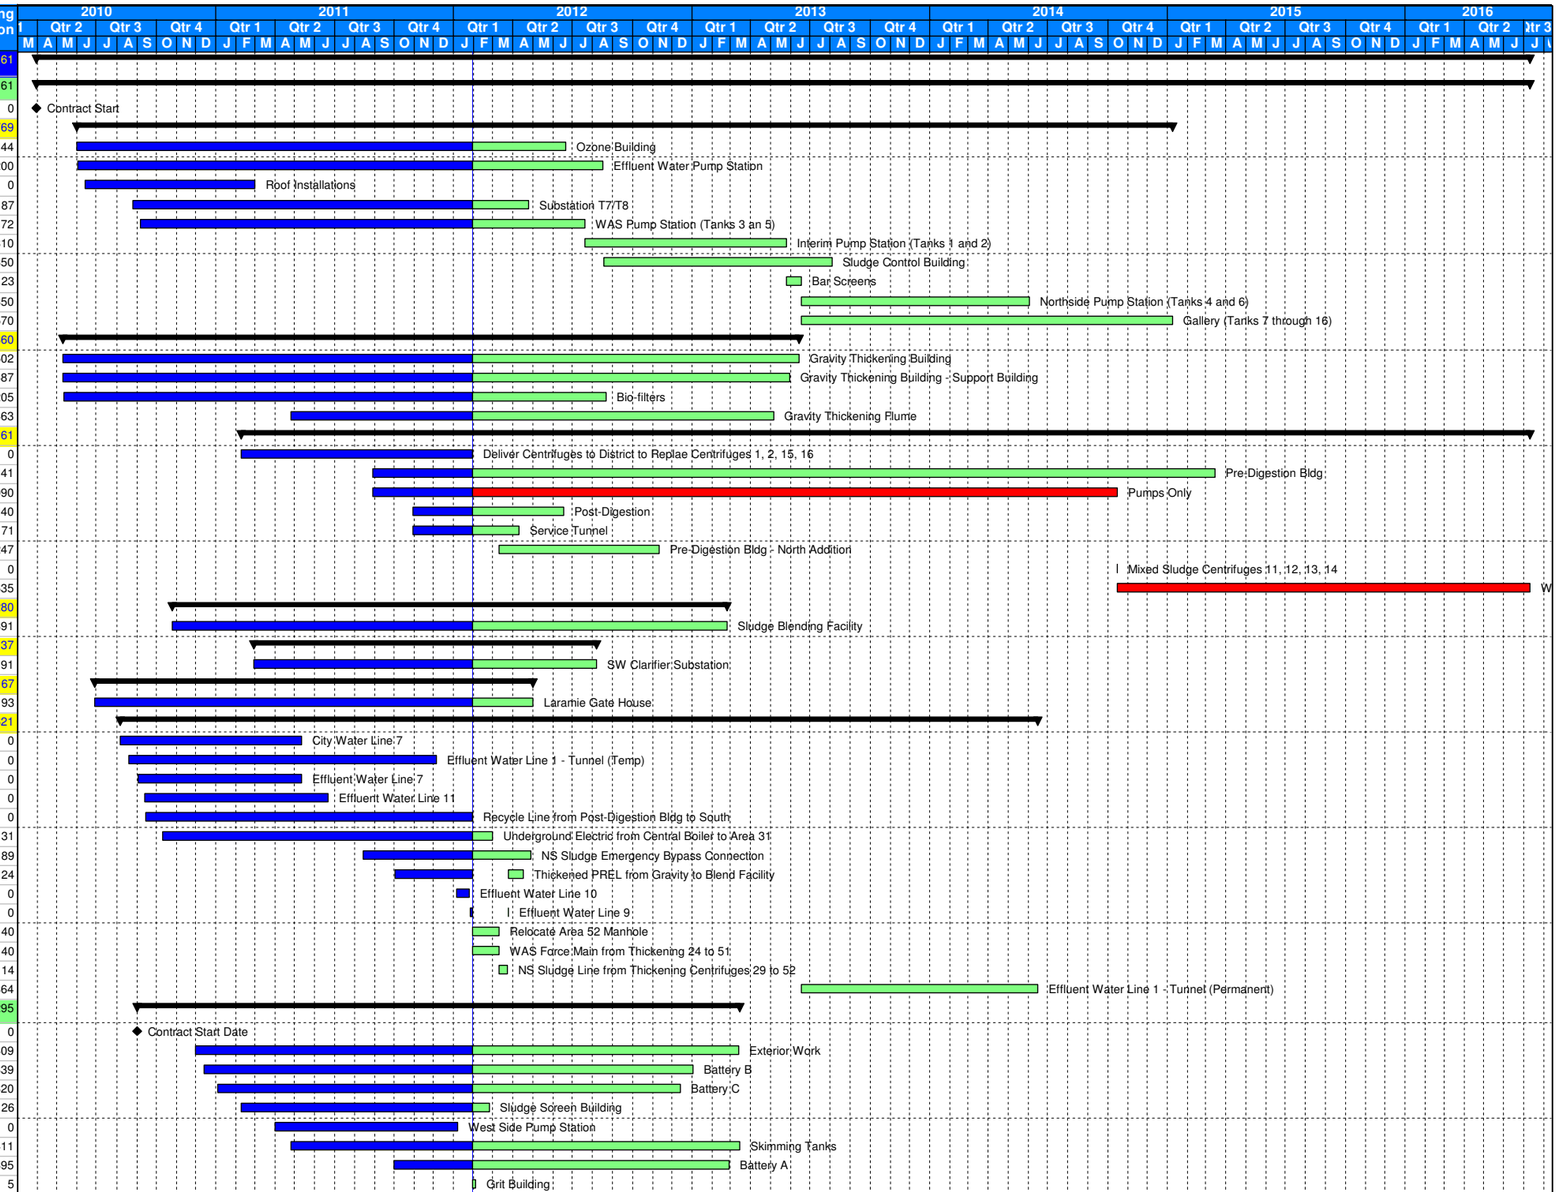

Start Date: 30-Mar-10 Data Date: 30-Jan-12

Finish Date: 11-Jul-16 Run Date: 27-Jan-12

Metropolitan Water Reclamation District of Greater Chicago

SWRP

Stickney Coordination Schedule

Sheet 1 of 1

Remaining Level of Effort
Actual Level of Effort
Actual Work
Remaining Work
Critical Remaining Work
Start Constraint
Finish Constraint
Milestone
Summary