

*Protecting Our Water Environment*



*Metropolitan Water Reclamation District of Greater Chicago*

***MONITORING AND RESEARCH  
DEPARTMENT***

***REPORT NO. 15-19***

***ODOR MONITORING PROGRAM AT THE METROPOLITAN WATER  
RECLAMATION DISTRICT OF GREATER CHICAGO'S SOLIDS DRYING  
AND SOLIDS PROCESSING FACILITIES DURING 2014***

***June 2015***

**Metropolitan Water Reclamation District of Greater Chicago**  
100 East Erie Street Chicago, Illinois 60611-2803 (312) 751-5600

ODOR MONITORING PROGRAM AT THE METROPOLITAN WATER RECLAMATION  
DISTRICT OF GREATER CHICAGO'S SOLIDS DRYING AND SOLIDS PROCESSING  
FACILITIES DURING 2014

By

Ali K. Oskouie  
Senior Environmental Research Scientist

Weizhe An  
Associate Environmental Research Scientist

## TABLE OF CONTENTS

	<u>Page</u>
LIST OF TABLES	i
LIST OF FIGURES	ii
ACKNOWLEDGMENTS	iii
LIST OF ACRONYMS	iv
DISCLAIMER	v
SUMMARY	vi
INTRODUCTION	1
RESULTS OF ODOR MONITORING AT THE METROPOLITAN WATER RECLAMATION DISTRICT OF GREATER CHICAGO’S SOLIDS DRYING AND SOLIDS PROCESSING FACILITIES IN 2014	3
Calumet Solids Drying Site	3
Harlem Avenue Solids Management Area, Vulcan, and Marathon Solids Drying Areas, and Lawndale Avenue Solids Management Area Solids Processing Site	3
Ridgeland Avenue Solids Management Area	8
Stony Island Solids Drying Area	8
APPENDIX	
Location of Odor Monitoring Stations at the Metropolitan Water Reclamation District of Greater Chicago Solids Drying Areas and Solids Processing Sites	AI

## LIST OF TABLES

<u>Table No.</u>		<u>Page</u>
1	Strong and Very Strong Odor Observations – 2014	vii
2	Odor Monitoring Program for 2014	2
3	Odor Monitoring Results for 2014	4
4	Hydrogen Sulfide Readings at the Calumet Solids Drying Sites – 2014	6
5	Hydrogen Sulfide Readings at the Harlem Avenue Solids Management Area, Vulcan, Marathon Solids Drying Areas, and Lawndale Avenue Solids Management Area Solids Processing Site – 2014	9
6	Hydrogen Sulfide Readings at the Ridgeland Avenue Solids Management Area and Stony Island Solids Drying Area – 2014	12

## LIST OF FIGURES

<u>Figure No.</u>		<u>Page</u>
1	Percent of Average Monthly Odor Observances at the Calumet Water Reclamation Plant Solids Drying Sites – 2014	5
2	Percent of Average Monthly Odor Observances at the Harlem Avenue Solids Management Area, Vulcan, Marathon Solids Drying Areas and Lawndale Avenue Solids Management Area Solids Processing Site – 2014	7
3	Percent of Average Monthly Odor Observances at the Ridgeland Avenue Solids Management Area – 2014	11
4	Percent of Average Monthly Odor Observances at the Stony Island Solids Drying Area – 2014	13
AI-1	Calumet Water Reclamation Plant and Calumet Water Reclamation Plant Solids Drying Areas	AI-1
AI-2	Harlem Avenue Solids Management Area, Vulcan, and Marathon Solids Drying Sites and Lawndale Avenue Solids Management Area Solids Processing Site	AI-2
AI-3	Ridgeland Avenue Solids Management Area Solids Drying Area	AI-3
AI-4	Stony Island Solids Drying Area	AI-4

## LIST OF ACRONYMS

District	Metropolitan Water Reclamation District of Greater Chicago
H <sub>2</sub> S	hydrogen sulfide
HASMA	Harlem Avenue Solids Management Area
LASMA	Lawndale Avenue Solids Management Area
M&O	Maintenance and Operations
M&R	Monitoring and Research
ppbv	parts per billion by volume
RASMA	Ridgeland Avenue Solids Management Area
SDAs	solids drying areas
SDS	solids drying site
SPS	solids processing site
WRP	water reclamation plant

## **ACKNOWLEDGMENTS**

The authors wish to acknowledge the assistance of the Maintenance and Operations Department personnel in carrying out odor monitoring activities at various facilities.

The efforts of the laboratory technicians, Messrs. Robert Bodnar, Marc Byrnes, Anthony Haizel, Shawn Kowalski, Harold Robinson, Edgar Herbas, and Thota Reddy in the Wastewater Treatment Process Research Section, who carried out the odor monitoring surveys and maintained the database are greatly appreciated.

Thanks are also due to Ms. Laura Franklin, Administrative Specialist, for her diligence in proofreading and formatting this report.

## **DISCLAIMER**

Mention of proprietary equipment in this report does not constitute endorsement by the Metropolitan Water Reclamation District of Greater Chicago.

## SUMMARY

The Metropolitan Water Reclamation District of Greater Chicago (District) has maintained a program of monitoring odors at one solids drying site (SDS), one solids processing site (SPS), and five solids drying areas (SDAs) since 1990. Both Monitoring and Research (M&R) Department and Maintenance and Operations (M&O) Department personnel made subjective observations regarding the type and intensity of any odor perceived. The M&R Department staff recorded instantaneous hydrogen sulfide (H<sub>2</sub>S) measurements using a handheld monitor at each monitoring site. The number of locations at each facility varied from 4 to 17. The frequency of monitoring varied from one to two days per week at the SDS, SDAs, and SPS. Each odor observation was characterized as very strong, strong, easily noticeable, faint, very faint, or no odor.

During 2014, one very strong odor was observed at the SPS. At all the areas that were monitored, the observations were characterized as faint to no odor from 77 to 99 percent of the time.

At each of the SDS, SDAs and SPS, there are specific locations which have noticeable odors. A summary of locations which had occasional strong or very strong odors is presented in Table 1.

The H<sub>2</sub>S levels generally followed a pattern similar to the odor observations with occasional high values. The average level of H<sub>2</sub>S ranged from 3.6 to 15.3 parts per billion by volume (ppbv) at the SDS, SDAs, and SPS.



TABLE 1: STRONG AND VERY STRONG ODOR OBSERVATIONS – 2014

Facility (Station Number)	Number of Strong Odor Observations	Number of Very Strong Odor Observations	Total Number of Observations
<b>Calumet SDS</b>			
East Drying Cell #1 SW (14)	1		
East Drying Cell #8 NW (16)	2		
East Drying Cell #8 NE (17)	1		
Truck Scale/Centrifuge (18)	2		
West Drying Cell #1 at Gate (20)	<u>2</u>	<u>0</u>	
	Total 8	0	507
<b>HASMA, Marathon, and Vulcan SDAs, and LASMA SPS</b>			
HASMA (1)	1		
Vulcan TARP DS (4)	2		
LASMA Lagoon #24 (8)	1		
LASMA Cell 1E – 1W (10)	2		
LASMA Cell 5E – 5W (14)		1	
Marathon (15)	1		
Marathon West (16)	<u>1</u>		
	Total 8	1	549
<b>RASMA SDA<sup>1</sup></b>			
	<u>0</u>	<u>0</u>	
	Total 0	0	124
<b>Stony Island SDA</b>			
	<u>0</u>	<u>0</u>	
	Total 0	0	122

<sup>1</sup>RASMA was not used as a biosolids drying site during 2014.

DS = Drop shaft.

HASMA = Harlem Avenue Solids Management Area.

LASMA = Lawndale Avenue Solids Management Area.

RASMA = Ridgeland Avenue Solids Management Area.

SDA = Solids Drying Area.

SDS = Solids Drying Site.

SPS = Solids Processing Site.

TARP = Tunnel and Reservoir Plan.

## INTRODUCTION

The M&R Department in conjunction with the M&O Department has been conducting an odor monitoring program at various District solids drying and processing facilities for the past 25 years. The program was initiated by the M&R Department to monitor the solids processing and drying sites at the Lawndale Avenue Solids Management Area (LASMA), Harlem Avenue Solids Management Area (HASMA), Marathon, and Vulcan in 1990, and was expanded to the Calumet SDS in 1992 and to the Ridgeland Avenue Solids Management Area (RASMA) and Stony Island SDA in 2001 as part of the District's Solids Drying Area operating permits.

At each location a similar procedure is followed to monitor odors. M&R Department personnel, and at some facilities M&O Department personnel, visit various locations at each facility on a regular basis. The odor monitoring personnel make subjective observations regarding the character and intensity of odors at each of the stations. The odor intensities are ranked on a scale of no odor, very faint, faint, easily noticeable, strong, and very strong. In addition to the subjective odor measurements, the ambient air is sampled and analyzed for H<sub>2</sub>S concentration using a Jerome Model 631-X H<sub>2</sub>S analyzer.

The objective of this program is to collect and maintain a database of odor levels within and around each solids drying and processing facility. This data can be used to study the trends in odor levels associated with solids drying and processing operations and to correlate odor levels to conditions related to solids drying and processing operations or changing conditions within the facility.

A summary of the odor monitoring program for the solids drying and processing facilities is presented in Table 2. This table includes a brief description of the program with regard to when the monitoring commenced at each facility, the number of monitoring locations, the frequency of the monitoring, who conducts the monitoring, if H<sub>2</sub>S is measured, and odor complaints.

Maps showing the odor monitoring locations are presented in Appendix AI.

The number of monitoring locations at each facility varies from 4 to 17, depending upon the size of the facility and the history of odor episodes at those facilities. The solids drying and processing facilities are monitored one or two days per week.

In 2014, odor complaints were received only at the Calumet SDS. The two complaints received were both verified.

This report presents the odor monitoring data for the year 2014. The odor monitoring data in terms of frequency of occurrence, locations of possible odor sources, and H<sub>2</sub>S levels have been reviewed and summarized.

TABLE 2: ODOR MONITORING PROGRAM FOR 2014

Facility	Number of Locations Monitored	Year Began	Months of Year	Days per Week	Departments Participating	H <sub>2</sub> S Measured	Number of Odor Complaints	Number of Complaints Verified
Calumet SDS	9	1992	12	1 2	M&R M&O	Yes	2	2
HASMA, Vulcan, and Marathon SDAs, and LASMA SPS	17	1990	12	1 to 2	M&R	Yes	0	0
RASMA SDA	4	2001	12	1 to 2	M&R	Yes	0	0
Stony Island SDA	4	2001	12	1	M&R	Yes	0	0

Note: HASMA = Harlem Avenue Solids Management Area  
 LASMA = Lawndale Avenue Solids Management Area  
 RASMA = Ridgeland Avenue Solids Management Area  
 SDA = Solids Drying Area.  
 SDS = Solids Drying Site.  
 SPS = Solids Processing Site.  
 M&R = Monitoring and Research Department.  
 M&O = Maintenance and Operations Department.

## **RESULTS OF ODOR MONITORING AT THE METROPOLITAN WATER RECLAMATION DISTRICT OF GREATER CHICAGO'S SOLIDS DRYING AND SOLIDS PROCESSING FACILITIES IN 2014**

The results of the various odor monitoring programs at each of the monitored sites for 2014 are summarized in [Table 3](#). The results have been divided into two major groups: significant odors, which include the very strong, strong, and easily noticeable odors, and insignificant odors, which are either faint, very faint, or no odors.

A general observation drawn from the table is that at the Calumet SDS, where both M&R and M&O Department personnel conducted odor monitoring, the M&O Department personnel show a lower percentage of odors detected. This may be due to the fact that the M&O Department personnel are exposed to the specific area on a daily basis as compared to the M&R Department personnel, which can result in olfactory desensitization. Thus, they may not differentiate especially well between faint and easily noticeable odors.

### **Calumet Solids Drying Site**

The Calumet SDS consists of the East SDA, located east of the Calumet Water Reclamation Plant (WRP), and the West SDA, located west of the Calumet WRP. The occurrence of strong odors at the drying areas, which also includes the non-operational centrifuge building located at the East SDA, was infrequent. The majority of the observations were described as faint to no odor. No very strong odors were detected in 2014. Strong odors were observed at the SDS in May, June, August, October, and November. Strong odors were observed mostly under five percent of the time on a monthly basis. Easily noticeable odors occurred between 0 and 30 percent of the time on a monthly basis throughout the various locations. [Figure 1](#) presents the monthly frequency of occurrence of the easily noticeable, strong, and very strong odor observations. The easily noticeable odors were highest during May 2014.

The average H<sub>2</sub>S levels were between 4.0 and 5.5 ppbv, as shown in [Table 4](#). The highest value observed (31 ppbv) was at East Drying Cell #1 SE.

Two odor complaints were received with regard to the Calumet SDS during 2014.

### **Harlem Avenue Solids Management Area, Vulcan, and Marathon Solids Drying Areas, and Lawndale Avenue Solids Management Area Solids Processing Site**

The HASMA, Vulcan, and Marathon SDAs and the LASMA SPS had 83 percent of the total observations characterized as faint to no odor. There were one very strong and eight strong odor observations out of 549 total observations. The very strong and strong odor observations were spread among the various locations (HASMA, Vulcan CS, LASMA Lagoon 24, LASMA Cell 1E-1W, LASMA Cell 5E-5W, Marathon, and Marathon West) depending upon the activity at the time.

The percentage of observations at which easily noticeable, strong, and very strong odors were observed was plotted by month and is presented in [Figure 2](#). The frequency of observed odors is generally highest during the spring through the fall months (April through October)

TABLE 3: ODOR MONITORING RESULTS FOR 2014

Facility	Departments Participating	Total Number of Observations	Number of Observations Significant Odors were Detected			Number Insignificant Odors <sup>1</sup>	Percent Insignificant Odors
			Very Strong	Strong	Easily Noticeable		
Calumet SDS	M&R	290	0	8	59	223	77
	M&O	217	0	0	3	214	99
HASMA, Vulcan, and Marathon SDAs, and LASMA SPS	M&R	549	1	8	87	453	83
RASMA SDA <sup>2</sup>	M&R	124	0	0	7	117	94
Stony Island SDA	M&R	122	0	0	4	118	97

Note: HASMA = Harlem Avenue Solids Management Area.  
 LASMA = Lawndale Avenue Solids Management Area.  
 RASMA = Ridgeland Avenue Solids Management Area.  
 SDA = Solids Drying Area.  
 SDS = Solids Drying Site.  
 SPS = Solids Processing Site.  
 M&R = Monitoring and Research Department.  
 M&O = Maintenance and Operations Department.

<sup>1</sup>Insignificant odors are all observations of faint, very faint, or no odor.

<sup>2</sup>RASMA SDA was not used as a biosolids drying site during 2014.

FIGURE 1: PERCENT OF AVERAGE MONTHLY ODOR OBSERVANCES AT THE CALUMET WATER RECLAMATION PLANT SOLIDS DRYING SITES – 2014

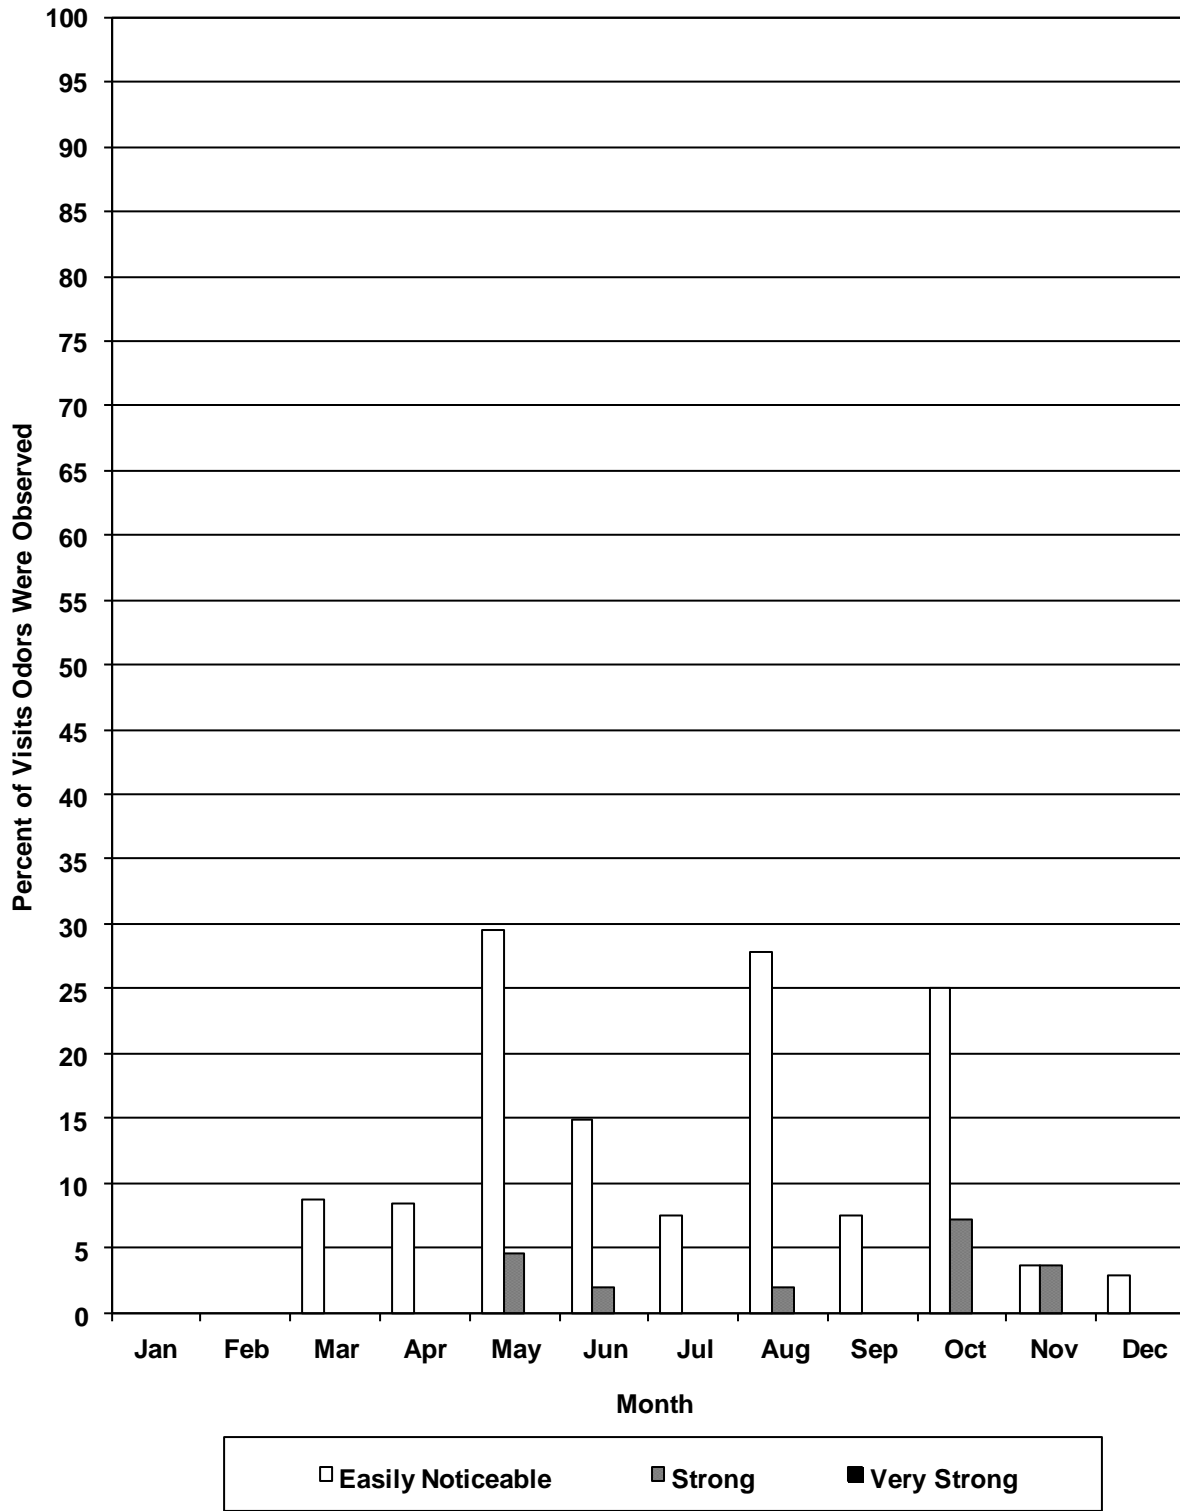


TABLE 4: HYDROGEN SULFIDE READINGS AT THE CALUMET SOLIDS DRYING SITES – 2014

Location	Hydrogen Sulfide, ppbv <sup>1</sup>		
	Mean <sup>2</sup>	Minimum <sup>3</sup>	Maximum
East Drying Cell #1 SW (14) <sup>4</sup>	4.6	0	12
Hopper Building (15)	4.2	0	10
East Drying Cell #8 NW (16)	5.4	0	12
East Drying Cell #8 NE (17)	5.2	0	10
Truck Scale/Centrifuge (18)	4.6	0	11
East Drying Cell #1 SE (19)	5.5	0	31
West Drying Cell #1 @ Gate (20)	4.7	0	11
West Drying Cell #4 (21)	5.4	0	20
Bituminous Road @ Gate (22)	4.0	0	10


<sup>1</sup>ppbv = Parts per billion by volume.

<sup>2</sup>Mean values are calculated using the average of all recordings by the Jerome hydrogen sulfide analyzer. The detection limit for the Jeromes is 3 ppbv, but is displayed as 0 ppbv on the meter. If the measurement is below the detection limit, 0 ppbv is used in the calculation.

<sup>3</sup>Minimum values are based on actual values displayed by the Jerome hydrogen sulfide analyzer. The detection limit for the Jeromes is 3 ppbv, but is displayed as 0 ppbv on the meter. If the measurement is below the detection limit, 0 ppbv is used in the minimum determination.

<sup>4</sup>Numbers in parentheses correspond to Station numbers in [Figure AI-1](#).

FIGURE 2: PERCENT OF AVERAGE MONTHLY ODOR OBSERVANCES AT THE HARLEM AVENUE SOLID MANAGEMENT AREA, VULCAN, MARATHON SOLIDS DRYING AREAS AND LAWNSDALE AVENUE SOLIDS MANAGEMENT AREA SOLIDS PROCESSING SITE – 2014

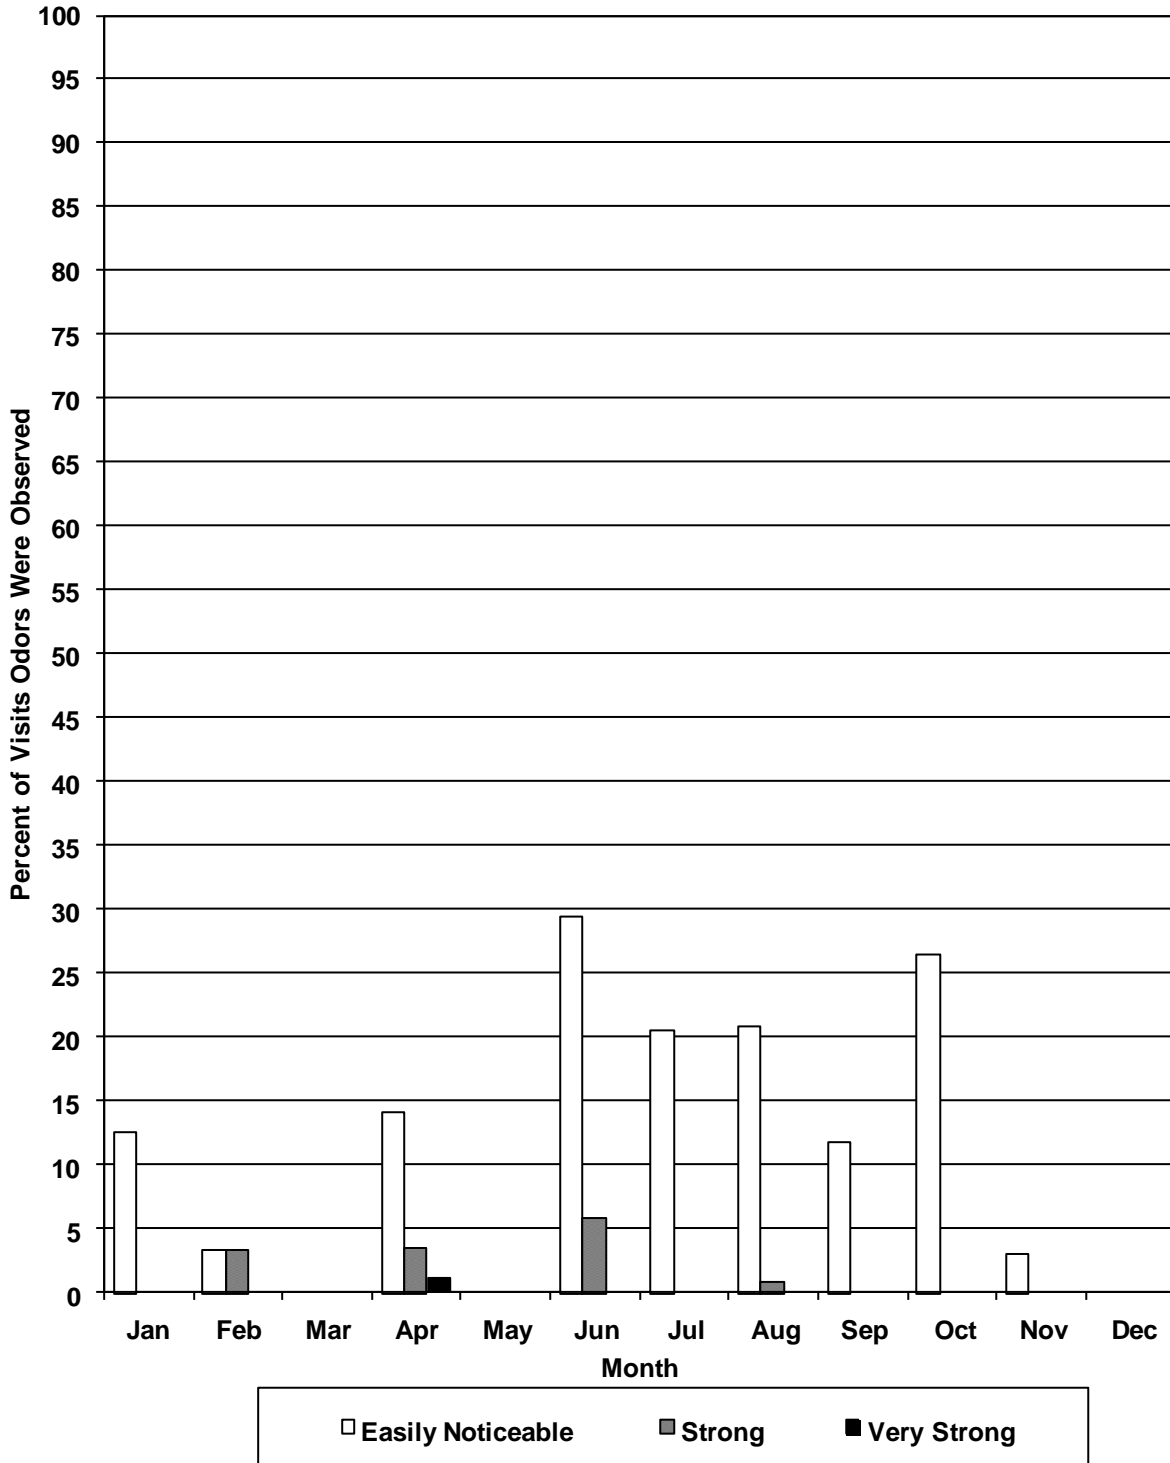



when solids processing and drying are being carried out. The easily noticeable odor observations ranged from 0 to 30 percent during this time period.

The average H<sub>2</sub>S levels at the various locations around these SDAs and SPS ranged from 3.6 to 15.3 ppbv as shown in Table 5.

No odor complaint was received in 2014 with regard to these solids drying and processing facilities.

### **Ridgeland Avenue Solids Management Area**

Although the Ridgeland Avenue Solids Management Area was not used as a biosolids drying site during 2014, it was used as a landscape waste composting site, which led to odor observances in the area. A monthly summary of the observations at RASMA of easily noticeable, strong, and very strong odors during 2014 is presented in Figure 3, expressed as frequency of occurrence. The highest frequency of odors was observed in May 2014. RASMA had 94 percent of the observations characterized as faint to no odor, with no strong odor observations in 2014.

The average H<sub>2</sub>S levels around RASMA, as shown in Table 6, varied from 3.7 to 4.2 ppbv.

No odor complaints were received in 2014 with regard to RASMA.

### **Stony Island Solids Drying Area**

The Stony Island SDA had 97 percent of the observations characterized as faint to no odor, with no strong odor observations in 2014.

A monthly summary of the observations at the Stony Island SDA of easily noticeable, strong, and very strong odors during 2014 is presented in Figure 4 expressed as frequency of occurrence. The highest frequency of odors was observed in May 2014.

The average H<sub>2</sub>S levels around the Stony Island SDA, as shown in Table 6, varied from 4.1 to 5.1 ppbv.

No odor complaints were received in 2014 with regard to the Stony Island SDA.

TABLE 5: HYDROGEN SULFIDE READINGS AT THE HARLEM AVENUE SOLIDS MANAGEMENT AREA, VULCAN, MARATHON SOLIDS DRYING AREAS, AND LAWNSDALE AVENUE SOLIDS MANAGEMENT AREA SOLIDS PROCESSING SITE – 2014

Location	Hydrogen Sulfide, ppbv <sup>1</sup>		
	Mean <sup>2</sup>	Minimum <sup>3</sup>	Maximum
HASMA (1) <sup>4</sup>	4.9	0	9
HASMA Center (1.5)	5.5	0	10
Vulcan South (2)	5.3	0	9
Vulcan North (3)	4.0	0	10
Vulcan TARP Drop Shaft (4)	5.6	0	9
Vulcan TARP Well (5)	3.6	0	7
LASMA Lagoon 1 (6)	4.8	0	9
LASMA Lagoon 16 (7)	5.3	0	10
LASMA Lagoon 24 (8)	6.5	0	11
LASMA Lagoon 30 (9)	15.3	0	57
LASMA Cell 1E-1W (10)	7.0	0	15
LASMA Cell 2E-2W (11)	6.1	0	11
LASMA Cell 3E-3W (12)	7.0	0	18
LASMA Cell 4E-4W (13)	6.1	0	11
LASMA Cell 5E-5W (14)	6.6	0	16

TABLE 5 (Continued): HYDROGEN SULFIDE READINGS AT THE HARLEM AVENUE SOLIDS MANAGEMENT AREA, VULCAN, MARATHON SOLIDS DRYING AREAS, AND LAWNSDALE AVENUE SOLIDS MANAGEMENT AREA SOLIDS PROCESSING SITE – 2014

Location	Hydrogen Sulfide, ppbv <sup>1</sup>		
	Mean <sup>2</sup>	Minimum <sup>3</sup>	Maximum
Marathon (15)	6.6	0	17
Marathon West (16)	6.4	0	11

<sup>1</sup>ppbv = Parts per billion by volume.

<sup>2</sup>Mean values are calculated using the average of all recordings by the Jerome hydrogen sulfide analyzer. The detection limit for the Jeromes is 3 ppbv, but is displayed as 0 ppbv on the meter. If the measurement is below the detection limit, 0 ppbv is used in the calculation.

<sup>3</sup>Minimum values are based on actual values displayed by the Jerome hydrogen sulfide analyzer. The detection limit for the Jeromes is 3 ppbv, but is displayed as 0 ppbv on the meter. If the measurement is below the detection limit, 0 ppbv is used in the minimum determination.

<sup>4</sup>Numbers in parentheses correspond to Station numbers in [Figure AI-2](#).

FIGURE 3: PERCENT OF AVERAGE MONTHLY ODOR OBSERVANCES AT THE RIDGELAND AVENUE SOLIDS MANAGEMENT AREA – 2014

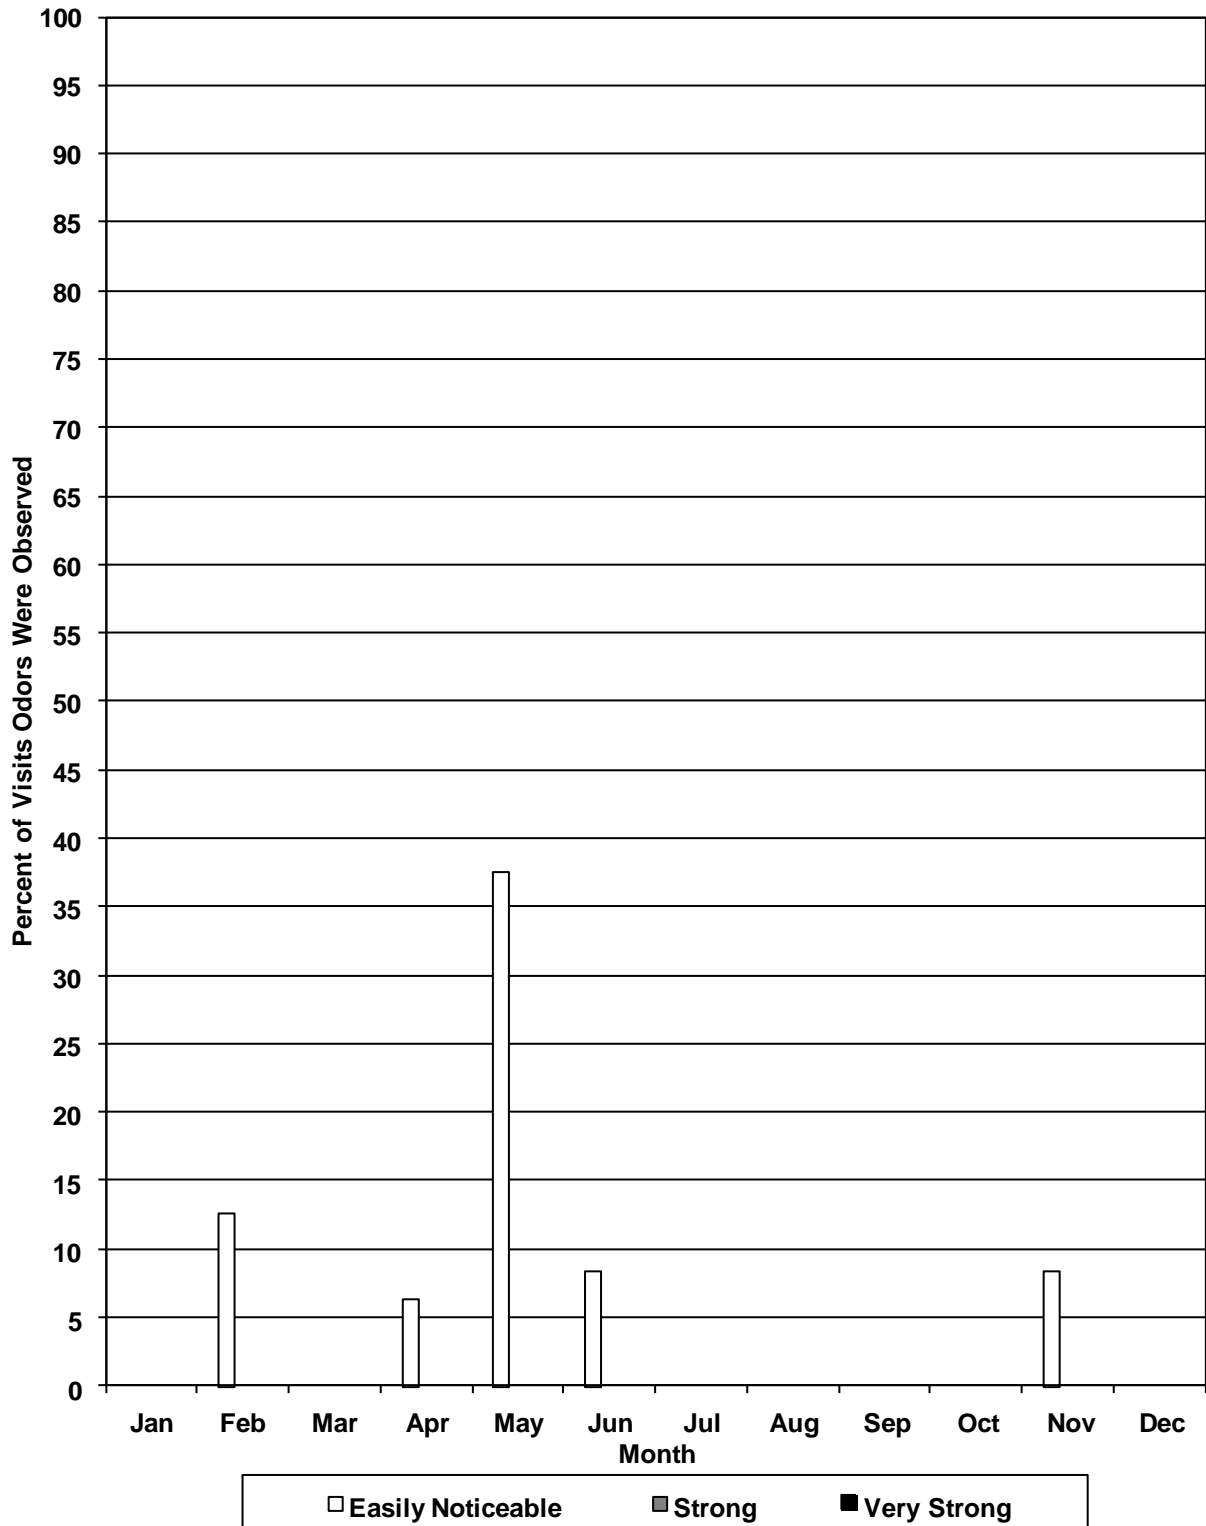


TABLE 6: HYDROGEN SULFIDE READINGS AT THE RIDGELAND AVENUE SOLIDS MANAGEMENT AREA AND STONY ISLAND SOLIDS DRYING AREA – 2014

Location	Hydrogen Sulfide, ppbv <sup>1</sup>		
	Mean <sup>2</sup>	Minimum <sup>3</sup>	Maximum
RASMA			
SW Parking Area (1) <sup>4</sup>	4.0	0	9.0
North of Cell 2W (2)	4.0	0	7.0
NE Corner Cell 5E (3)	3.7	0	6.5
South of Cell 5 (4)	4.2	0	8.5
Stony Island			
Entrance 122nd St (1) <sup>5</sup>	4.1	0	8.5
NE Corner Cell 5 (2)	4.5	0	7.0
South End Cells 4 & 7 (3)	5.1	0	9.0
West Side of Cell 3 (4)	4.8	0	8.0

<sup>1</sup>ppbv = Parts per billion by volume.


<sup>2</sup>Mean values are calculated using the average of all recordings by the Jerome hydrogen sulfide analyzer. The detection limit for the Jeromes is 3 ppbv, but is displayed as 0 ppbv on the meter. If the measurement is below the detection limit, 0 ppbv is used in the calculation.

<sup>3</sup>Minimum values are based on actual values displayed by the Jerome hydrogen sulfide analyzer. The detection limit for the Jeromes is 3 ppbv, but is displayed as 0 ppbv on the meter. If the measurement is below the detection limit, 0 ppbv is used in the minimum determination.

<sup>4</sup>Numbers in parentheses correspond to Station numbers in [Figure AI-3](#).

<sup>5</sup>Numbers in parentheses correspond to Station numbers in [Figure AI-4](#).


FIGURE 4: PERCENT OF AVERAGE MONTHLY ODOR OBSERVANCES AT THE STONY ISLAND DRYING AREA – 2014

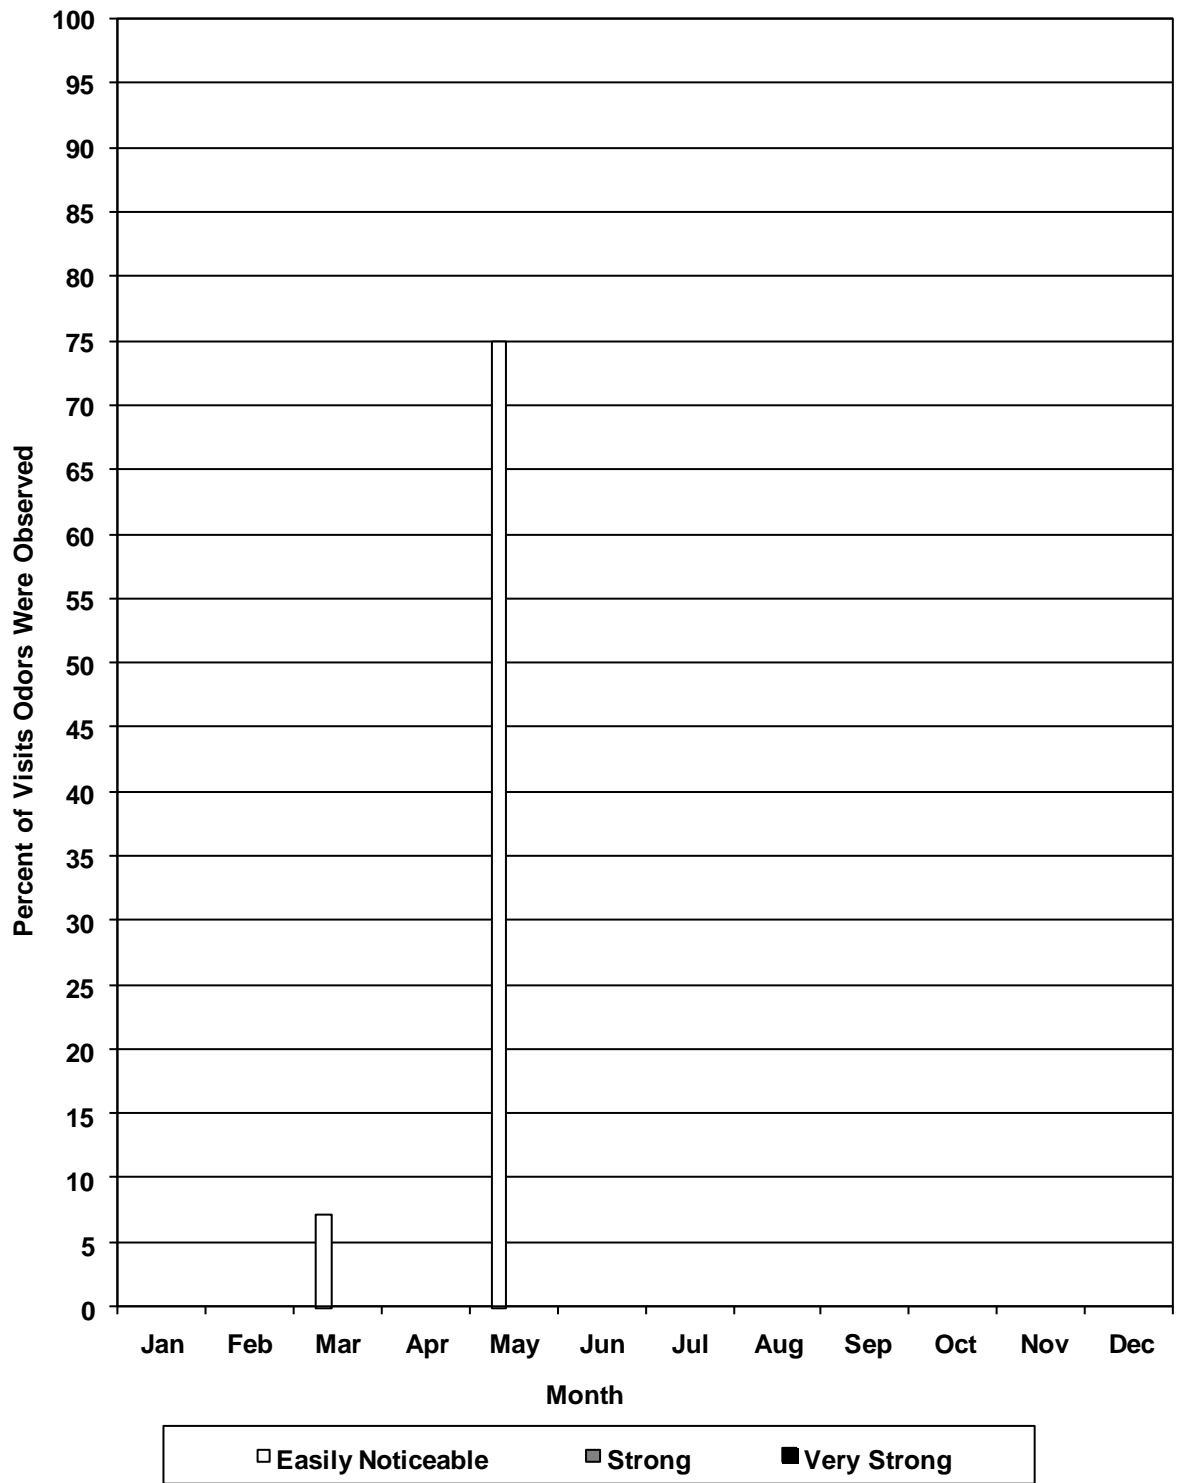

APPENDIX AI

LOCATION OF ODOR MONITORING STATIONS AT THE METROPOLITAN WATER  
RECLAMATION DISTRICT OF GREATER CHICAGO SOLIDS DRYING AREAS AND  
SOLIDS PROCESSING SITES

FIGURE AI-1: CALUMET WATER RECLAMATION PLANT AND CALUMET WATER RECLAMATION PLANT SOLIDS DRYING AREAS\*

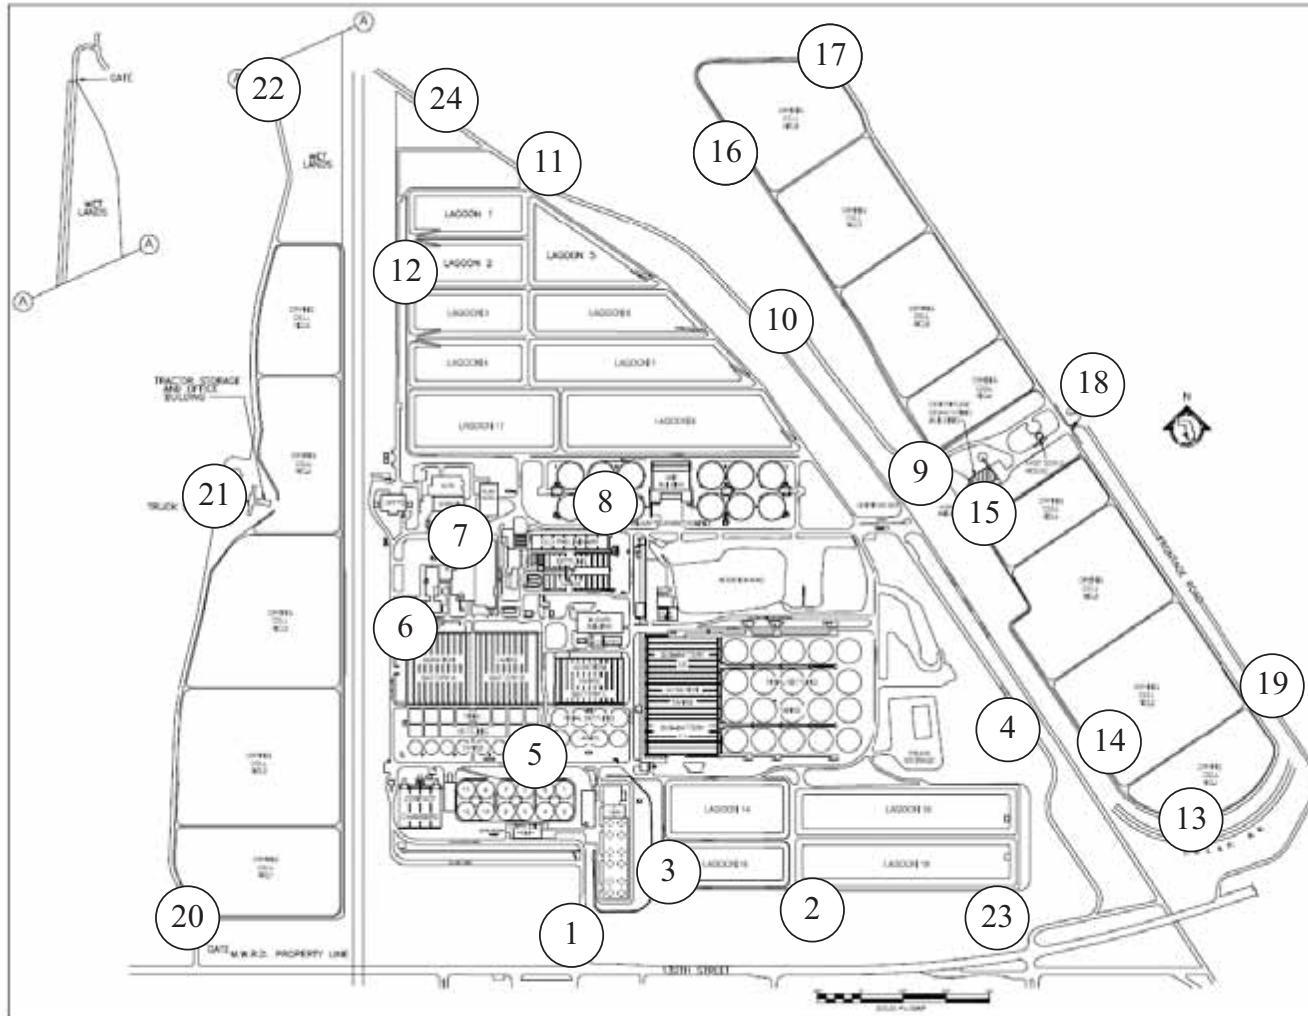


I-IV

\*Numbered circles (14–22) indicate odor monitoring locations for Solids Drying Areas.




FIGURE AI-2: HARLEM AVENUE SOLIDS MANAGEMENT AREA, VULCAN, AND MARATHON SOLIDS DRYING SITES AND LAWNSDALE AVENUE SOLIDS MANAGEMENT AREA SOLIDS PROCESSING SITE\*

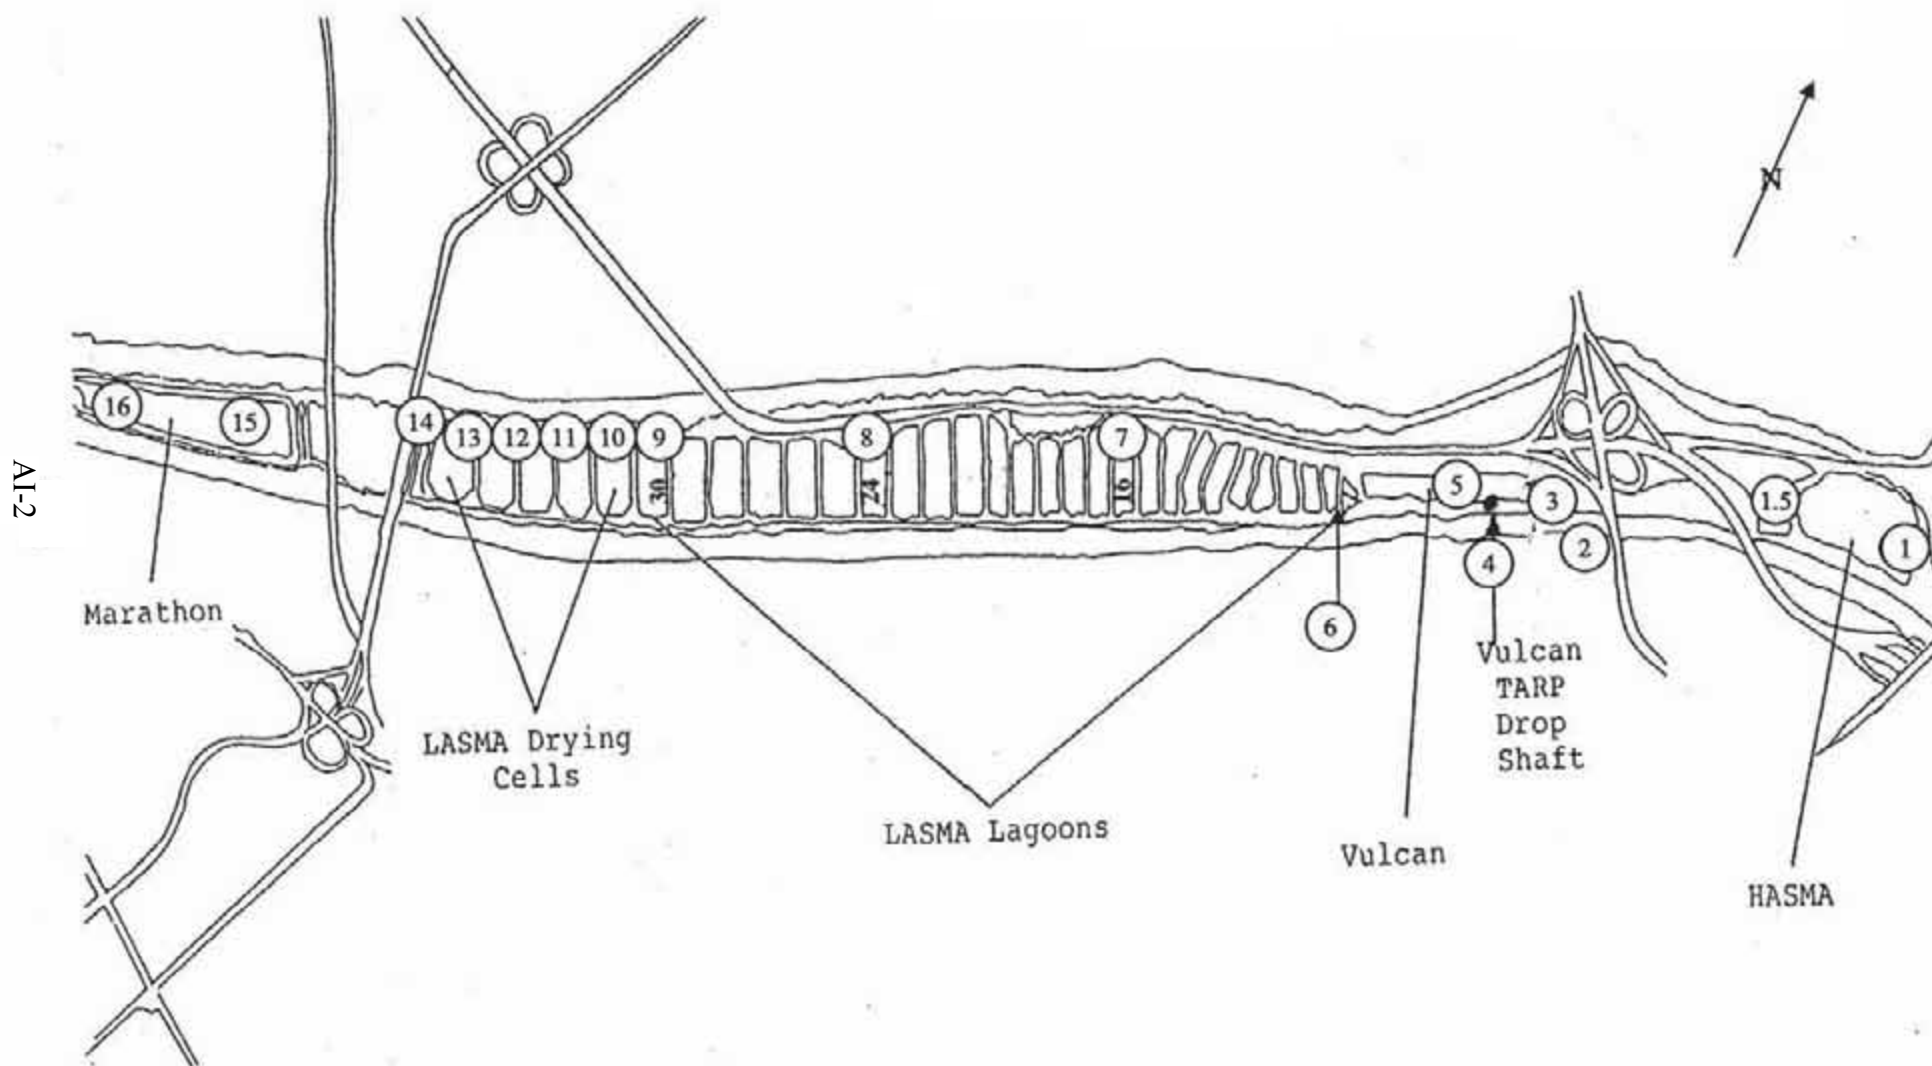

\*Numbered circles indicate odor monitoring locations.


FIGURE AI-3: RIDGELAND AVENUE SOLIDS MANAGEMENT AREA SOLIDS DRYING AREA\*

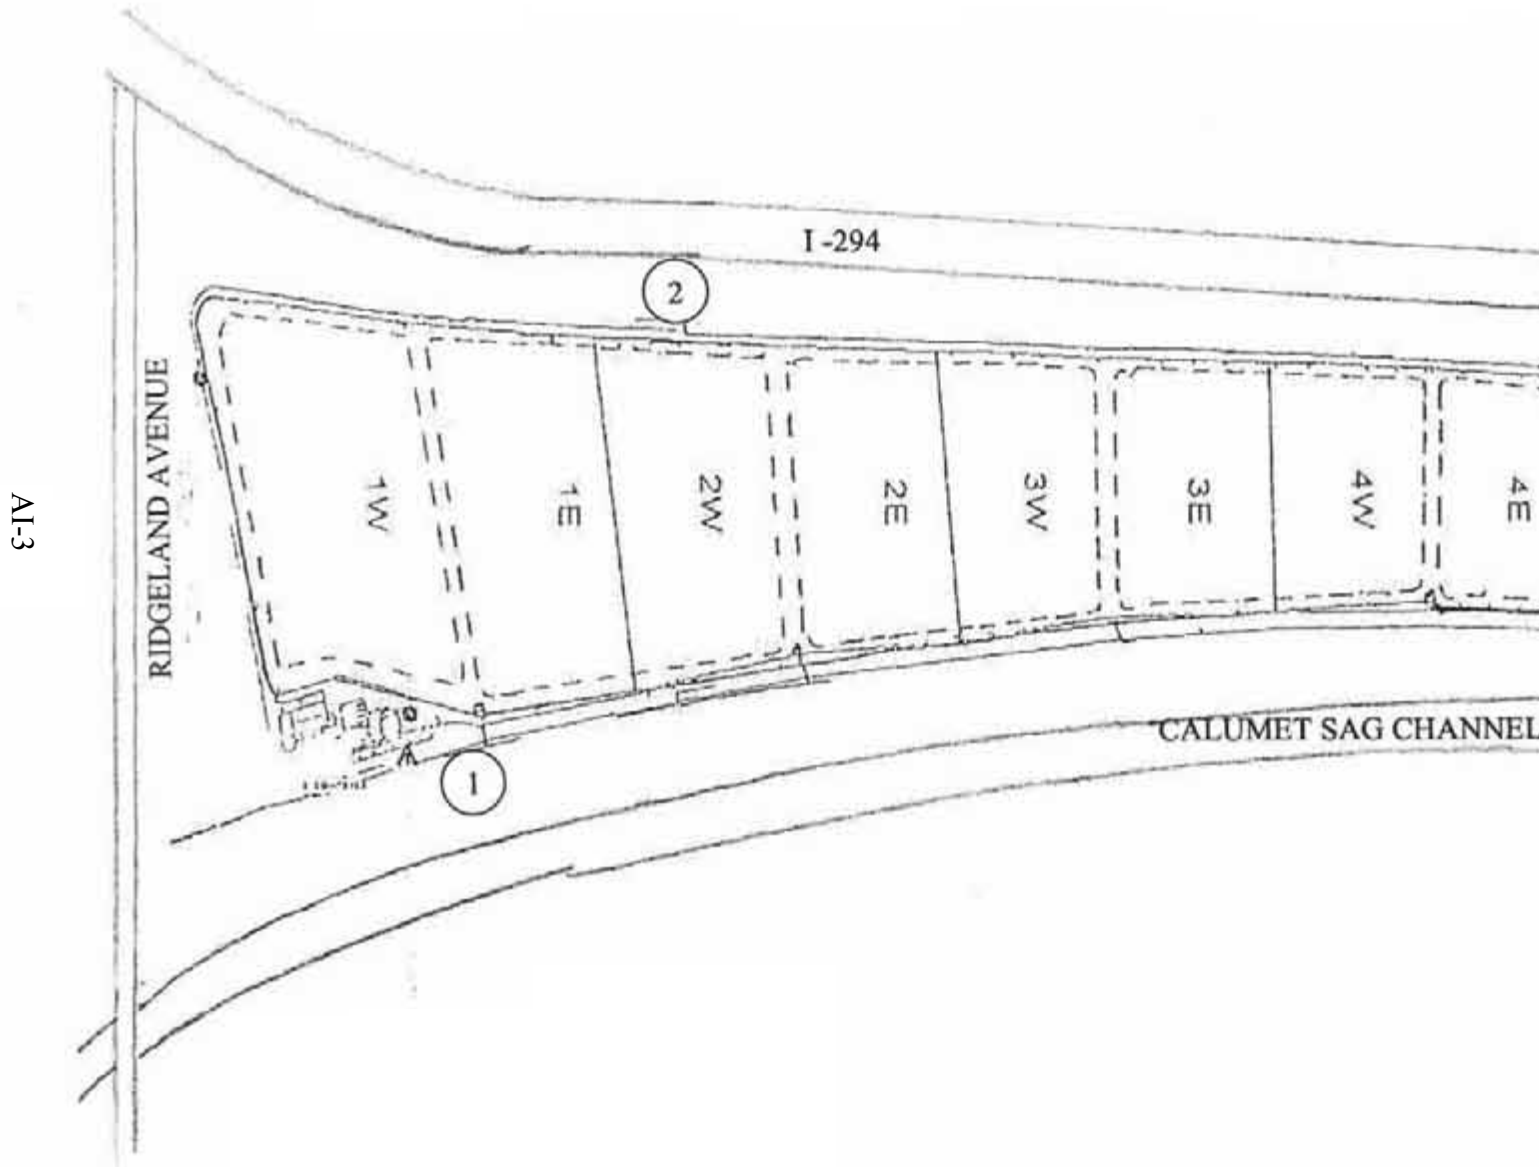

AI-3

\*Numbered circles indicate odor monitoring locations.

FIGURE AI-4: STONY ISLAND SOLIDS DRYING AREA\*

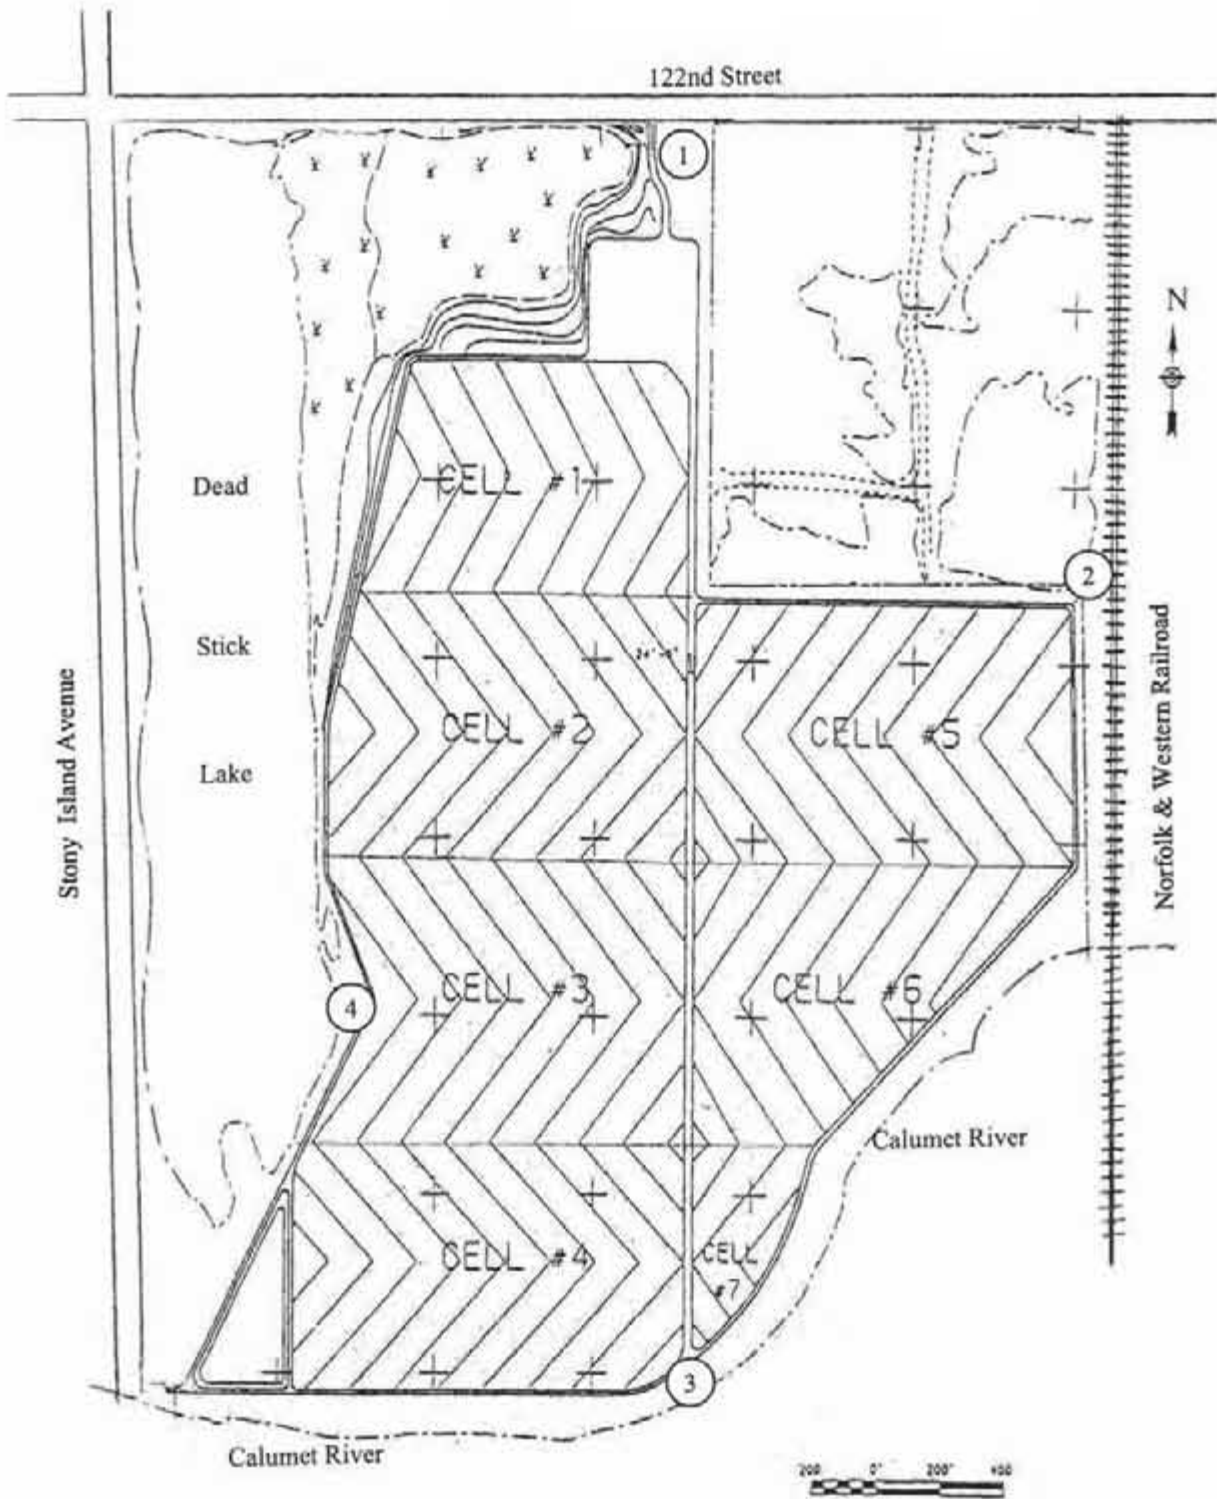

\*Numbered circles indicate odor monitoring locations.